

UNDERGROUND SERVICE

200 AMP Maximum

***ATTENTION *** A DISCONNECT BREAKER IS REQUIRED !!!


You will need to put marker tape in ditch

No service can be mounted on the outside wall of a mobile or manufactured home without proof of HUD approval, which must be provided to the Cooperative. Kentucky does not recognize modular homes.

- 1.) Meter base to be attached securely. Lead anchors or toggle bolts to be used on brick veneer or equivalent. Plastic anchors will not be permitted.
- 2.) Grounding Electrode conductor shall be unspliced and have 6 inches exposed for the interconnection of other systems. Electrical non-metallic, or metallic conduit shall be used for protection. If using metallic conduit, bond both ends.
- 3.) 3 inch rigid conduit (metal or PVC) attached with two bolt mast clamps a continuous run of conduit limited to 3 - 90 ft. bends extended to predetermined utility pole/pedestal. Extend conduit one foot above final grade at pole. Temporarily cap or close end of conduit.

All PVC subject to physical damage shall be SCH. 80.

- 4.) Ground movement requires direct buried conductors to have "S" loop in trench at conduit transition. Continuous conduit runs must have expansion fitting.

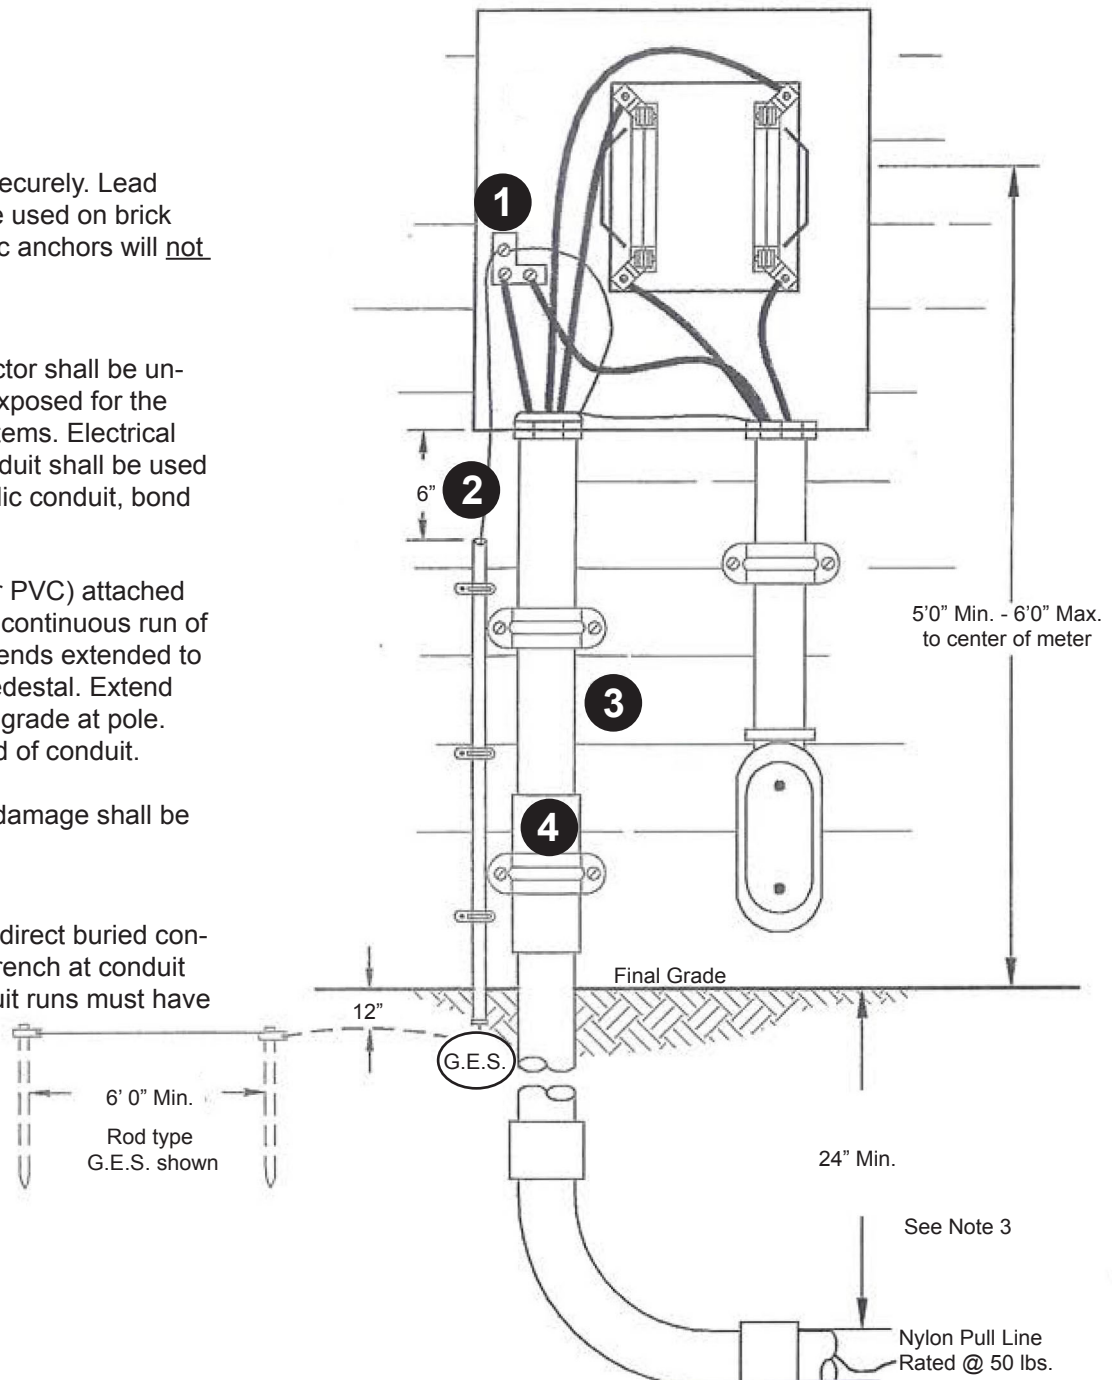

UNDERGROUND SERVICE

200 AMP Maximum

***ATTENTION - A DISCONNECT BREAKER IS REQUIRED.

You will need to put marker tape in ditch

No service can be mounted on the outside wall of a mobile or manufactured home without proof of HUD approval, which must be provided to the Cooperative. Kentucky does not recognize modular homes.

